




SINGLE BLUEWAVE

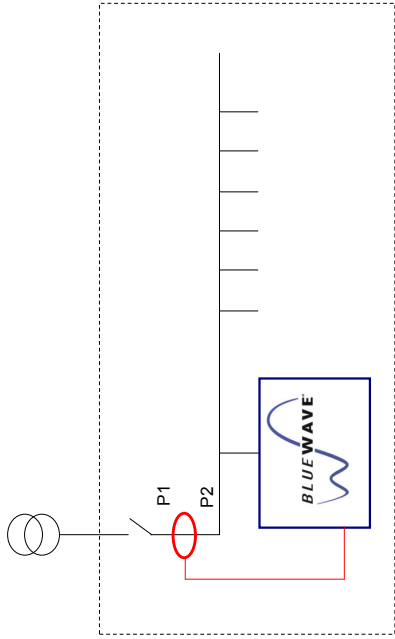


or

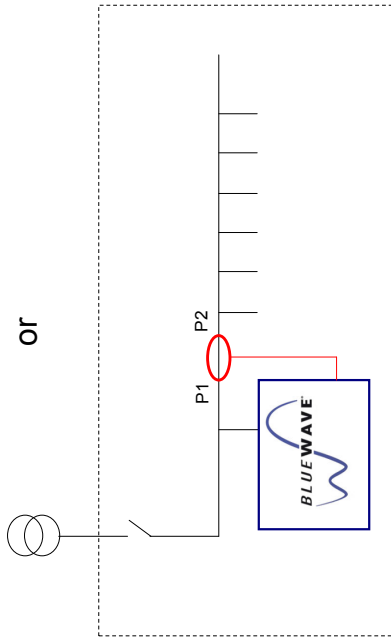

MULTIPLE BLUEWAVE

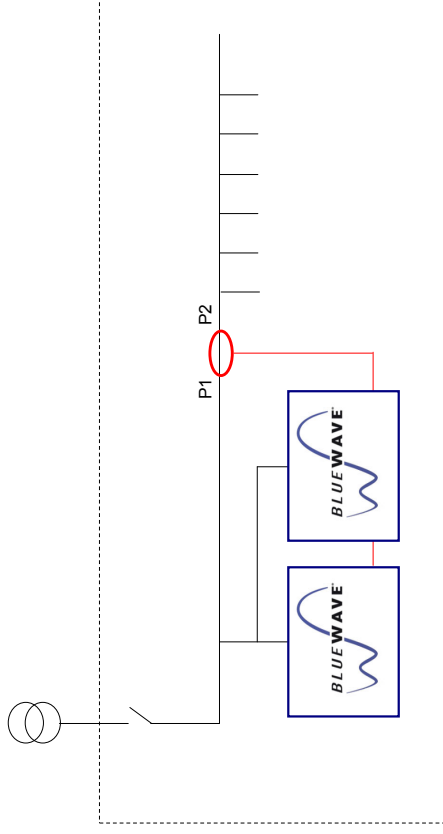

or

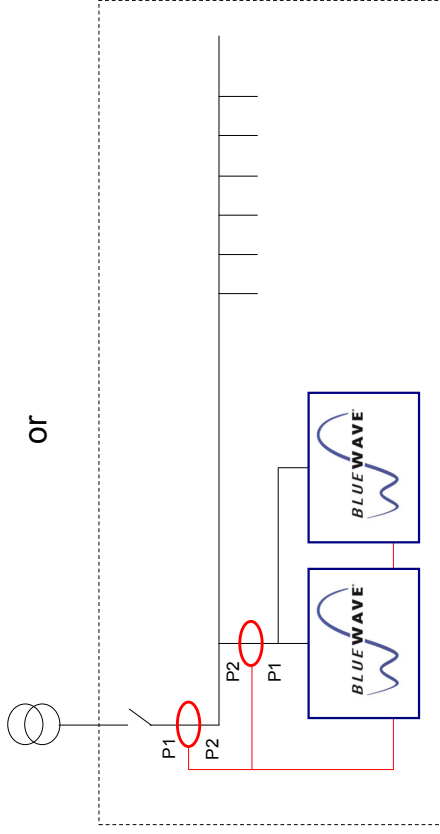

NOTES

1. Ensure P1 and P2 (CT polarity) are facing direction shown.
2. Download relevant wiring diagram for CT terminal designations.
3. For multiple incoming supplies contact us.



Power Quality Management Ltd
 PO Box 76
 Blakeney
 Gloucestershire GL15 4DE
 t 01594 510670
 f 01594 516170
 e info@pqmanagement.co.uk
www.pqmanagement.co.uk

CT POSITION OPTIONS

additional information is available
 at www.bluewaveuk.com

DO NOT SCALE

DRAWING NO. D02022003402

DRWN	IK	CHKD	CA	Date	15-04-08
REVISION			DATE	DETAILS	