

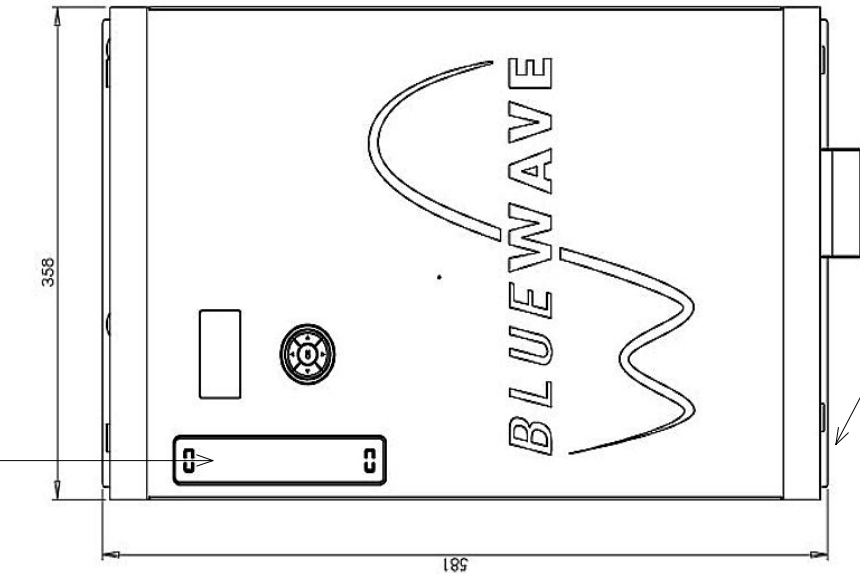


REMOTE INDICATION TERMINALS

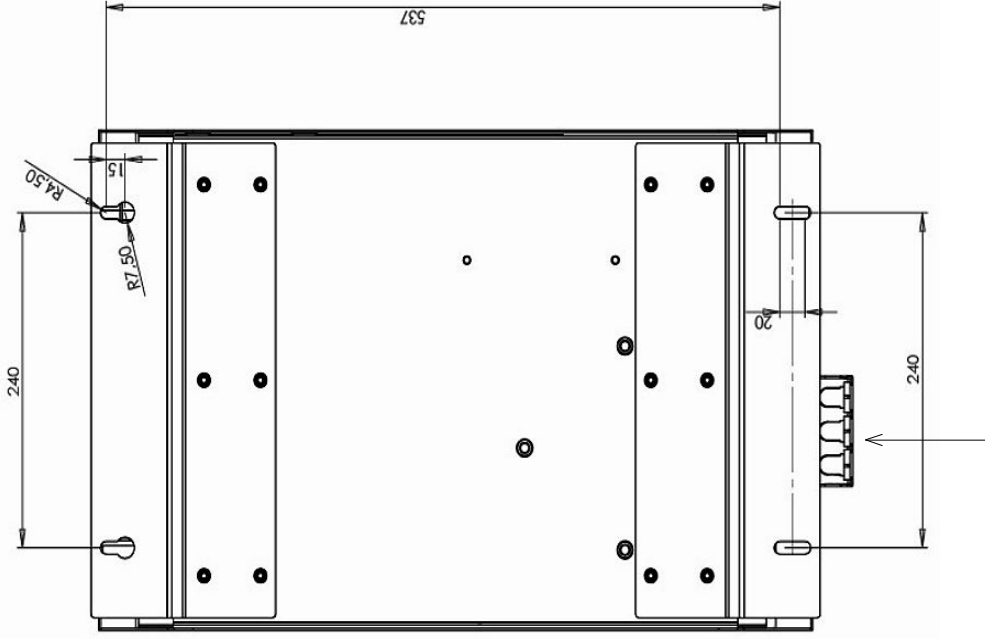

CT INPUT TERMINALS

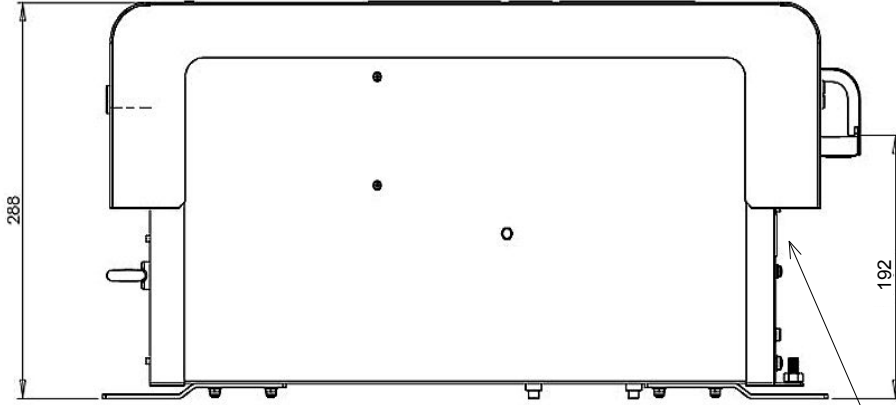

NOTES

1. 5A secondary CT's input terminals are adjacent to power cable terminals
2. A CT shorting facility must be provided before terminating to the Active Filter
3. See www.bluewaveuk.com for more installation support information



Power Quality Management Ltd
 PO Box 76
 Blakeney
 Gloucestershire GL15 4DE
 t 01594 510670
 f 01594 516170
 e info@pqmanagement.co.uk
www.pqmanagement.co.uk

BLUEWAVE ACTIVE HARMONIC FILTER
30/50A 3-WIRE IP20

WEIGHT 47Kg
 VENTILATION 350m³/h
 more product information is available from:
www.bluewaveuk.com

DO NOT SCALE

DRAWING NO. D020223050320

DRWN	IK	CHKD	CA	Date	15-04-08
REVISION			DATE	DETAILS	